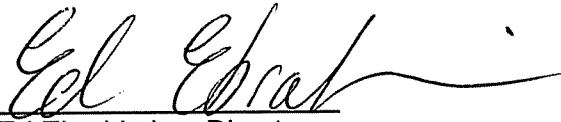


BUREAU OF STREET LIGHTING DIRECTIVE NO. 415

SPECIFICATION OF CONDUIT & WIRE SIZE

Effective immediately, all plans specifying low voltage circuits shall utilize 1" conduit with #8 AWG Stranded THWN/THHN wire, unless otherwise warranted by voltage drop calculations. In addition, all street crossings shall be a minimum, 1 ½ " conduit.

Multiple Circuit Notes & Delta Notes on plan templates shall be updated to reflect these changes.

A handwritten signature in black ink, appearing to read 'Ed Ebrahimian', with a long horizontal flourish extending to the right.

Ed Ebrahimian, Director
Bureau of Street Lighting

Date: July 9, 2012

Distribution: Engineering Staff and FOD Supervisors